


IB IL 24 DI 16 ...

Inline Terminal With 16 Digital Inputs

AUTOMATIONWORX

Data Sheet
5553_en_04

© PHOENIX CONTACT - 09/2007

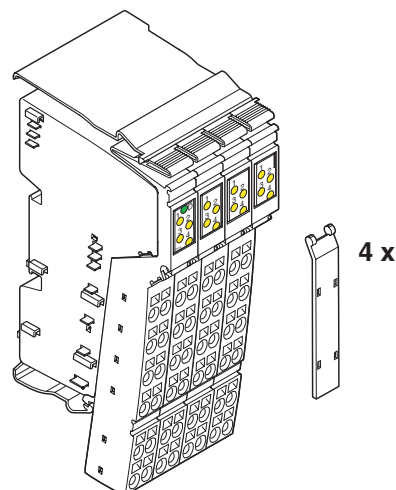

Description

The terminal is designed for use within an Inline station. It is used to acquire digital signals.

Features

- Connections for 16 digital sensors
- Connection of sensors in 2 and 3-wire technology
- Maximum permissible load current per sensor: 250 mA
- Maximum permissible load current from the terminal: 4.0 A
- Diagnostic and status indicators
- **IB IL 24 DI 16 and IB IL 24 DI 16-PAC:**
Approved for use in potentially explosive areas (observe the notes on page 6)



This data sheet is only valid in association with the IL SYS INST UM E user manual or the Inline system manual for your bus system.



Please note that the numbering of the terminal points differs for the various connector versions (see Figure 2 on page 5).



Make sure you always use the latest documentation.
It can be downloaded at www.download.phoenixcontact.com.
A conversion table is available on the Internet at
www.download.phoenixcontact.com/general/7000_en_00.pdf.



This data sheet is valid for all products listed on the following page:

Ordering Data

Products

Description	Type	Order No.	Pcs./Pck.
Terminal with 16 digital inputs; complete with accessories (connectors consecutively numbered and labeling fields); transmission speed of 500 kbps	IB IL 24 DI 16-PAC	2861250	1
Terminal with 16 digital inputs; complete with accessories (connectors not consecutively numbered and labeling fields); transmission speed of 500 kbps	IB IL 24 DI 16-PAC/SN	2862958	1
Terminal with 16 digital inputs; without accessories; transmission speed of 500 kbps	IB IL 24 DI 16	2726230	1
Terminal with 16 digital inputs; complete with accessories (connectors not consecutively numbered and labeling fields); transmission speed of 2 Mbps	IB IL 24 DI 16-2MBD-PAC	2861595	1
Terminal with 16 digital inputs; complete with accessories (connectors not consecutively numbered and labeling fields); transmission speed of 2 Mbps	IB IL 24 DI 16-2MBD-PAC/SN	2878120	1
Terminal with 16 digital inputs; without accessories; transmission speed of 2 Mbps	IB IL 24 DI 16-2MBD	2855114	1



Four of the listed connectors or one connector set are needed for the complete fitting of the IB IL 24 DI 16 and IB IL 24 DI 16-2MBD.

Accessories

Description	Type	Order No.	Pcs./Pck.
Connector with twelve spring-cage connections (green, without color print)	IB IL SCN-12	2726340	10
Connector with twelve spring-cage connections (green, with color print)	IB IL SCN-12-ICP	2727611	10
Connector set with 48 spring-cage connections (green, without color print)	IB IL DI/DO 16-PLSET	2860976	1
Connector set numbered consecutively with 48 spring-cage connections (green, with color print)	IB IL DI 16-PLSET/ICP	2860989	1

Documentation

Description	Type	Order No.	Pcs./Pck.
"Automation Terminals of the Inline Product Range" user manual	IL SYS INST UM E	2698737	1
"Configuring and Installing the INTERBUS Inline Product Range" user manual	IB IL SYS PRO UM E	2743048	1
"INTERBUS Addressing" data sheet	DB GB IBS SYS ADDRESS	9000990	1
"Inline Terminals for Use in Zone 2 Potentially Explosive Areas" application note	AH EN IL EX ZONE 2	7217	1
"Addressing of 16-Channel Inline Terminals" application note	AH IB IL 24 DI/DO 16 ADDRESS	9014124	1

Technical Data

General Data

Housing dimensions (width x height x depth)	48.8 mm x 120 mm x 71.5 mm
Weight	122 g (without connectors), 210 g (with connectors)
Operating mode	Process data mode with 1 word
Connection method for sensors	2 and 3-wire technology
Permissible temperature (operation)	-25°C to +55°C
Permissible temperature (storage/transport)	-25°C to +85°C
Permissible humidity (operation/storage/transport)	10% to 95% according to DIN EN 61131-2
Permissible air pressure (operation/storage/transport)	70 kPa to 106 kPa (up to 3000 m above sea level)
Degree of protection	IP20 according to IEC 60529
Protection class	Class 3 according to EN 61131-2, IEC 61131-2
Connection data for connectors	
Connection method	Spring-cage terminals
Conductor cross-section	0.2 mm ² to 1.5 mm ² (solid or stranded), 24 - 16 AWG

Interface

Local bus	Through data routing
-----------	----------------------

Transmission Speed

IB IL 24 DI 16-PAC	500 kbps
IB IL 24 DI 16-PAC/SN	500 kbps
IB IL 24 DI 16	500 kbps
IB IL 24 DI 16-2MBD-PAC	2 Mbps
IB IL 24 DI 16-2MBD-PAC/SN	2 Mbps
IB IL 24 DI 16-2MBD	2 Mbps

Supply of the Module Electronics and I/O Through Bus Terminal/Power Terminal

Connection method	Through potential routing
-------------------	---------------------------

Power Consumption

	500 kbps	2 Mbps
Communications power	7.5 V	7.5 V
Current consumption from the local bus	60 mA, maximum	80 mA, maximum
Power consumption from the local bus	0.45 W, maximum	0.6 W, maximum
Segment supply voltage U_S	24 V DC (nominal value)	24 V DC (nominal value)
Nominal current consumption at U_S	4 A, maximum	4 A, maximum

Digital Inputs

Number	16
Input design	According to EN 61131-2 Type 1
Definition of switching thresholds	
Maximum low-level voltage	$U_{Lmax} < 5 \text{ V}$
Minimum high-level voltage	$U_{Hmin} > 15 \text{ V}$
Common potentials	Segment supply, ground
Nominal input voltage U_{IN}	24 V DC
Permissible range	$-30 \text{ V} < U_{IN} < +30 \text{ V DC}$
Nominal input current for U_{IN}	3 mA, minimum
Delay time	None
Permissible cable length to the sensor	30 m (to ensure conformance with EMC directive 89/336/EEC)
Use of AC sensors	AC sensors in the voltage range $< U_{IN}$ are limited in application (according to the input design)

Characteristic Curve: Current Depending on the Input Voltage and the Ambient Temperature T_A			
Supply Voltage	Input Current	Input Current for $t \geq 20$ s	
		For $T_A = 25^\circ\text{C}$	For $T_A = 55^\circ\text{C}$
18 V	3.0 mA	2.9 mA	2.5 mA
24 V	3.9 mA	3.8 mA	3.5 mA
30 V	4.5 mA	4.2 mA	3.0 mA

The current is reduced depending on the ambient temperature T_A and the number of inputs that are switched on (internal module temperature).

Power Dissipation

Formula to Calculate the Power Dissipation of the Electronics

500 kbps

$$P_{EL} = 0.525 \text{ W} + \sum_{n=1}^{16} [U_{INn} \times 0.003 \text{ A}]$$

2 Mbps

$$P_{EL} = 0.6 \text{ W} + \sum_{n=1}^{16} [U_{INn} \times 0.003 \text{ A}]$$

Where

P_{EL} Total power dissipation in the terminal
 n Index of the number of set inputs $n = 1$ to 16
 U_{INn} Input voltage of input n

Power Dissipation of the Housing P_{HOU}

2.8 W, maximum (within the permissible operating temperature)

Limitation of Simultaneity, Derating

Derating

No limitation of simultaneity, no derating

Error Messages to the Higher-Level Control or Computer System

None

Safety Equipment

Overload in segment circuit

No

Surge voltage

Protective elements in the power terminal

Polarity reversal

Protective elements in the power terminal

Electrical Isolation/Isolation of the Voltage Areas



To provide electrical isolation between the logic level and the I/O area it is necessary to supply the station bus coupler and the digital input terminal described here via the bus coupler or a power terminal from separate power supply units. Interconnection of the power supply units in the 24 V area is not permitted (see also user manual).

Common Potentials

The 24 V main voltage, 24 V segment voltage, and GND have the same potential. FE is a separate potential area.

Separate Potentials in the System Consisting of Bus Terminal/Power Terminal and I/O Terminal

Test Distance

5 V supply incoming remote bus/7.5 V supply (bus logic)

5 V supply outgoing remote bus/7.5 V supply (bus logic)

7.5 V supply (bus logic)/24 V supply (I/O)

24 V supply (I/O)/functional earth ground

Test Voltage

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.


500 V AC, 50 Hz, 1 min.

Approvals

For the latest approvals, please visit www.download.phoenixcontact.com or eshop.phoenixcontact.com.

Local Diagnostic and Status Indicators and Terminal Point Assignment

Local Diagnostic and Status Indicators

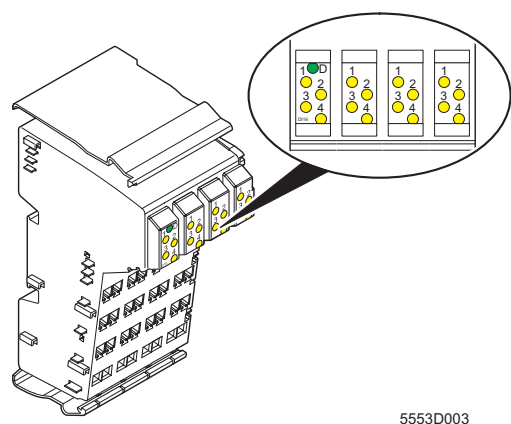

5553D003

Figure 1 Local diagnostic and status indicators


Des.	Color	Meaning
D	Green	Diagnostics
For Each Connector		
1, 2, 3, 4	Yellow	Status indicators of the inputs

Function Identification

Light blue

2 Mbps: White stripe in the vicinity of the D LED

Terminal Point Assignment for Each Connector

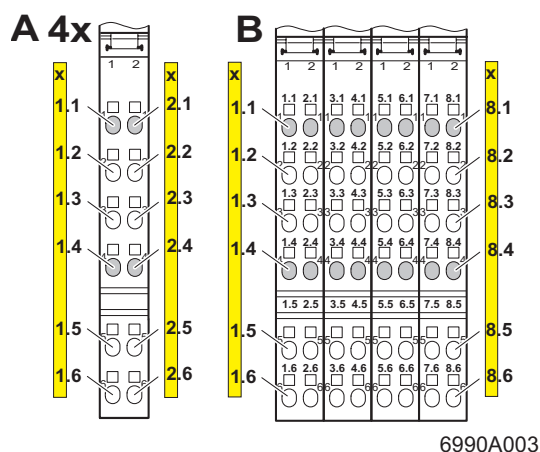

6990A003


Figure 2 Terminal point numbering:
individual connectors (A) and connector
sets (B)

- A** – Using the IB IL 24 DI 16-PAC/SN and IB IL 24 DI 16-2MBD-PAC/SN with the connectors provided
 - Using individual connectors (IB IL SCN-12 or IB IL SCN-12-ICP)
- B** – Using the IB IL 24 DI 16-PAC and IB IL 24 DI 16-2MBD-PAC with the original connector set
 - Using the IB IL 24 DI 16-PLSET/ICP or IB IL DI/DO 16-PLSET connector sets

Terminal Point	Assignment
x.1	Signal input (IN)
x.2	Segment voltage U_S for 2 and 3-wire termination
x.3	Ground contact (GND) for 3-wire termination
x.4	Signal input (IN)
x.5	Segment voltage U_S for 2 and 3-wire termination
x.6	Ground contact (GND) for 3-wire termination

Notes on Using the Terminal in Potentially Explosive Areas for the IB IL 24 DI 16 and IB IL 24 DI 16-PAC Terminals

Approval According to EC Directive 94/9 (ATEX)

 II 3G Ex nAC IIC T4 X

This Inline terminal conforms to the requirements of protection type "n" and can be installed in a zone 2 potentially explosive area. This Inline terminal is a category 3G item of electrical equipment.



WARNING: Explosion hazard
Only Inline terminals that are approved for use in potentially explosive areas may be snapped next to this Inline terminal.

Before using an Inline terminal in a zone 2 potentially explosive area, first check that the terminal has been approved for installation in this area.

For a list of terminals approved for zone 2 potentially explosive areas, please refer to the AH EN IL EX ZONE 2 application note.

Check the labeling on the Inline terminal and the packaging (see Figure 3).

 II 3G Ex nAC IIC T4 X
Potential rating 4 A maximum
for use in Ex areas

IBx IL xx xx x
Order-No.: xxxxxxxx
Module-ID: xx HW/FW xx/-
PHOENIX CONTACT
INTERBUS



Pho. Ch. Syst. For the Conn.
IB IL 24 DI 16-17
5553 0000 0000 0000 0000 0000 0000 0000

5561C001

Figure 3 Typical labeling of terminals for use in potentially explosive areas



WARNING: Explosion hazard

Before startup, ensure that the following points and instructions are observed.

1. When working on the Inline terminal, always disconnect the supply voltage.
2. The Inline terminal must only be installed, started up, and maintained by qualified specialist personnel.
3. Install the Inline terminals in a control cabinet or metal housing. The minimum requirement for both items is IP54 protection according to EN 60529.
4. The Inline terminal must not be subject to mechanical strain and thermal loads, which exceed the limits specified in the product documentation.
5. The Inline terminal must not be repaired by the user. Repairs may only be carried out by the manufacturer. The Inline terminal is to be replaced by an approved terminal of the same type.
6. Only category 3G equipment may be connected to Inline terminals in zone 2.
7. Observe all applicable standards and national safety and accident prevention regulations for installing and operating equipment.

Restrictions



WARNING: Explosion hazard

When using terminals in potentially explosive areas, observe the technical data and limit values specified in the corresponding documentation (user manual, data sheet, package slip).



WARNING: Explosion hazard; Restrictions regarding the Inline system

The **maximum permissible current** through the potential jumpers U_M and U_S (total current) is limited to **4 A** when using this Inline terminal in potentially explosive areas.

Internal Basic Circuit Diagram


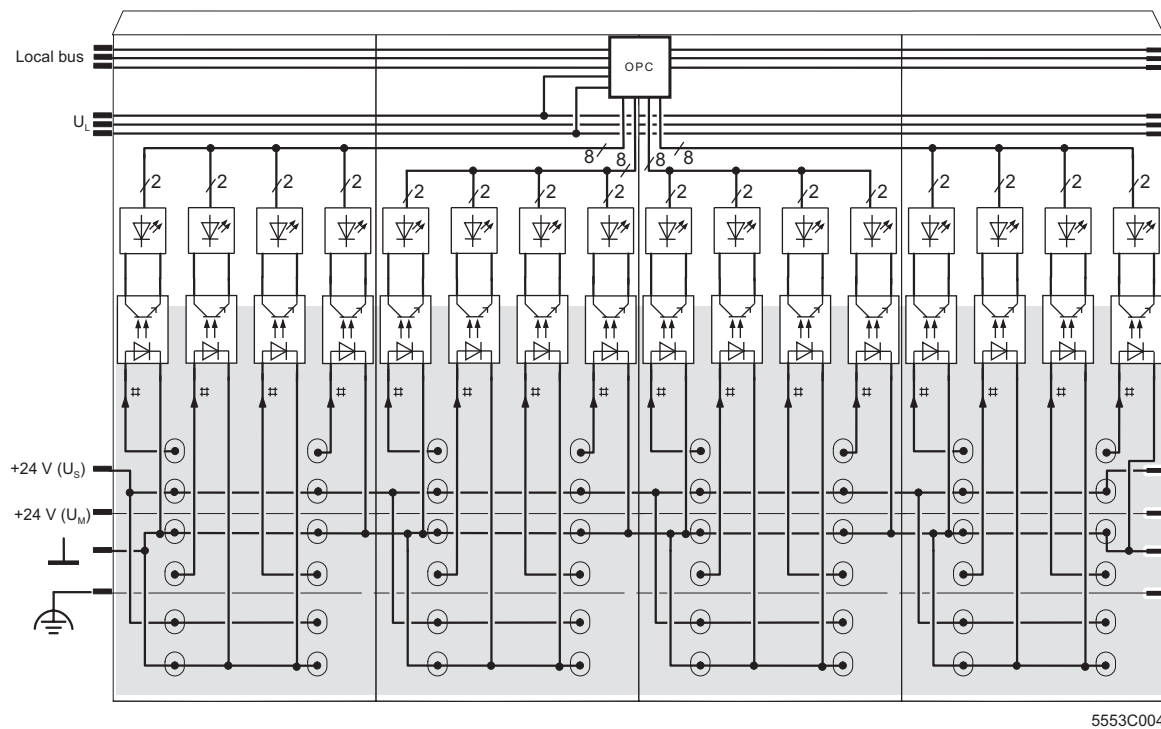


Figure 4 Internal wiring of the terminal points

Key:

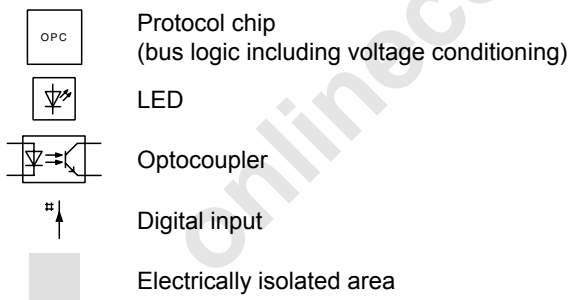

Other symbols used are explained in the
IL SYS INST UM E user manual or in the Inline
system manual for your bus system.


Connection Notes and Connection Example



Please note that the terminal must be provided with supply voltage U_S , as it is used internally as the auxiliary supply.



When connecting the sensors observe the assignment of the terminal points to the process data (see page 9).

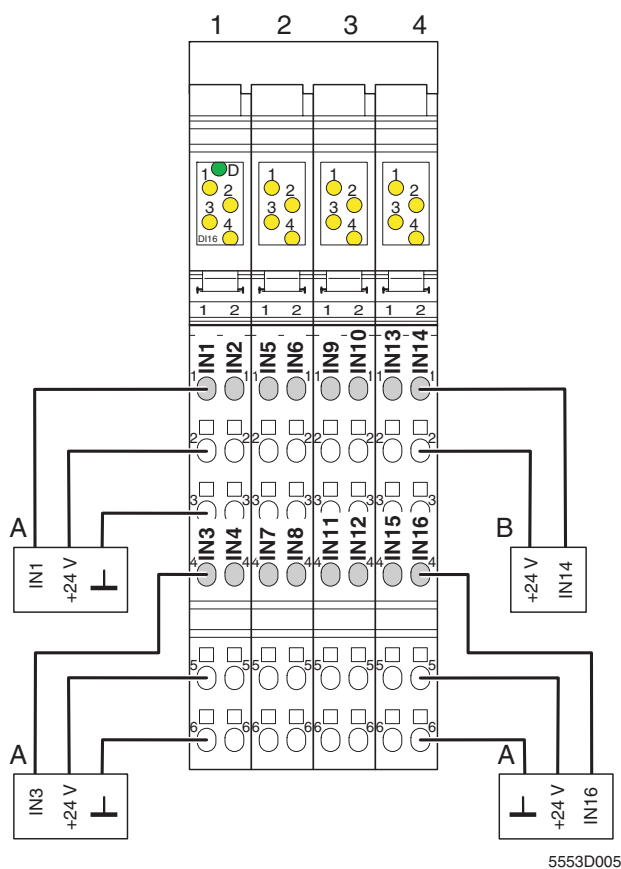

5553D005

Figure 5 Typical connection of sensors

A 3-wire termination

B 2-wire termination

The numbers above the module illustration indicate the connector slots.

Programming Data/Configuration Data

Local Bus (INTERBUS)

ID code	BE _{hex} (190 _{dec})
Length code	01 _{hex}
Process data channel	16 bits
Input address area	1 word
Output address area	0 words
Parameter channel (PCP)	0 words
Register length (bus)	1 word

Other Bus Systems



For the programming data/configuration data of other bus systems, please refer to the corresponding electronic device data sheet (e.g., GSD, EDS).

Process Data



For the assignment of the illustrated (byte.bit) view to your **INTERBUS** control or computer system, please refer to the DB GB IBS SYS ADDRESS data sheet.

For the assignment of the illustrated (byte.bit) view to control systems of **other bus systems**, please refer to the AH IB IL 24 DI/DO ADDRESS document.

Assignment of the Terminal Points to the IN Process Data



The following table applies to the IB IL 24 DI 16-PAC and IB IL 24 DI 16-2MBD-PAC with the original connector set and when using the IB IL DI/DO 16-PLSET or IB IL DI 16-PLSET/ICP connector sets (see also Figure 2 on page 5, detail B).

(Word.bit) view	Word	Word 0															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
(Byte.bit) view	Byte	Byte 0								Byte 1							
	Bit	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0
Module	Slot	4				3				2				1			
	Terminal point (signal)	8.4	7.4	8.1	7.1	6.4	5.4	6.1	5.1	4.4	3.4	4.1	3.1	2.4	1.4	2.1	1.1
	Terminal point (+24 V)	8.5	7.5	8.2	7.2	6.5	5.5	6.2	5.2	4.5	3.5	4.2	3.2	2.5	1.5	2.2	1.2
	Terminal point (GND)	8.6	7.6	8.3	7.3	6.6	5.6	6.3	5.3	4.6	3.6	4.3	3.3	2.6	1.6	2.3	1.3
Status indication	Slot	4				3				2				1			
	LED	4	3	2	1	4	3	2	1	4	3	2	1	4	3	2	1



The following table applies to the IB IL 24 DI 16-PAC/SN and IB IL 24 DI 16-2MBD-PAC/SN with the original connector set and when using the B IL SCN-12 or IB IL SCN-12-ICP connectors (see also Figure 2 on page 5, detail A).

(Word.bit) view	Word	Word 0															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
(Byte.bit) view	Byte	Byte 0								Byte 1							
	Bit	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0
Module	Slot	4				3				2				1			
	Terminal point (signal)	2.4	1.4	2.1	1.1	2.4	1.4	2.1	1.1	2.4	1.4	2.1	1.1	2.4	1.4	2.1	1.1
	Terminal point (+24 V)	2.5	1.5	2.2	1.2	2.5	1.5	2.2	1.2	2.5	1.5	2.2	1.2	2.5	1.5	2.2	1.2
	Terminal point (GND)	2.6	1.6	2.3	1.3	2.6	1.6	2.3	1.3	2.6	1.6	2.3	1.3	2.6	1.6	2.3	1.3
Status indication	Slot	4				3				2				1			
	LED	4	3	2	1	4	3	2	1	4	3	2	1	4	3	2	1